

MODEL: CSS-J4D2O-SMT | DESCRIPTION: MAGNETIC BUZZER TRANSDUCER

FEATURES

RoH

- surface mount
- side sound port
- externally driven




SPECIFICATIONS

parameter	conditions/description	min	typ	max	units
rated voltage	Vo-p		3.6		Vo-p
operating voltage		3		5	Vo-p
current consumption	at rated voltage, 3,100 Hz square wave, ½ duty			80	mA
rated frequency			3,100		Hz
sound pressure level	at 5 cm (A-weight), rated voltage, 3,100 Hz square wave, ½ duty	90	97		dBA
coil resistance		17	20	23	Ω
dimensions	8.5 x 8.5 x 3.2				mm
weight			0.7		g
material	L.C.P. (white)				
terminal	SMT type (Au plating)				
operating temperature		-40		70	°C
storage temperature		-40		85	°C
RoHS	yes				

SOLDERABILITY


.....

parameter	conditions/description	min	typ	max	units
reflow soldering	see reflow solder profile			260	°C

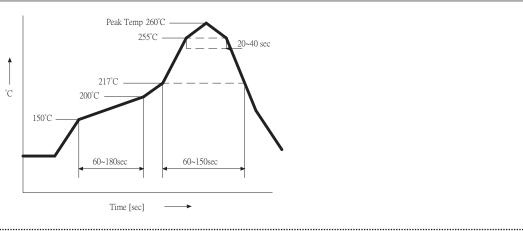


.....

MECHANICAL DRAWING

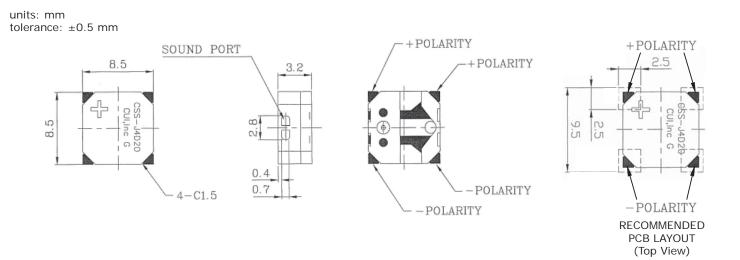


FREQUENCY RESPONSE CURVE

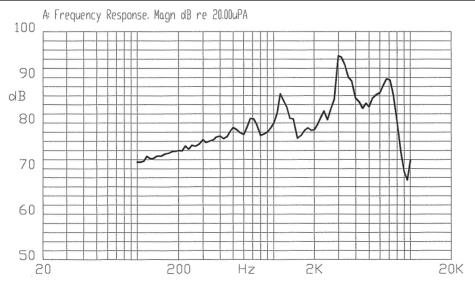

MEASUREMENT METHOD

.....

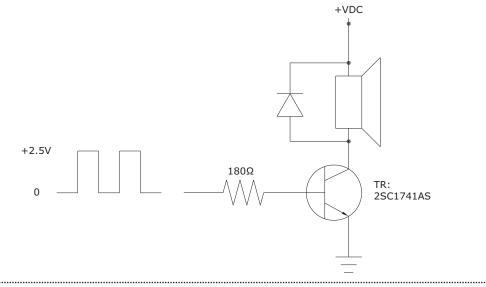

REVISION HISTORY

rev.	description	date	
1.0	initial release	09/20/2006	
1.01	applied new spec template	11/03/2008	
1.02	updated part number, added TR package option, applied new spec template	05/06/2013	

The revision history provided is for informational purposes only and is believed to be accurate.



Headquarters 20050 SW 112th Ave. Tualatin, OR 97062 800.275.4899

Fax 503.612.2383 **cui**.com techsupport@cui.com

CUI offers a one (1) year limited warranty. Complete warranty information is listed on our website.

CUI reserves the right to make changes to the product at any time without notice. Information provided by CUI is believed to be accurate and reliable. However, no responsibility is assumed by CUI for its use, nor for any infringements of patents or other rights of third parties which may result from its use.

CUI products are not authorized or warranted for use as critical components in equipment that requires an extremely high level of reliability. A critical component is any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.